


NOTES:

- 1.) FILTER #1 SHOULD HAVE A CAPACITY TO SUPPLY SUFFICIENT WATER FOR THE WHOLE HOUSE - BIRD DEMAND. CAN BE WASHABLE OR REUSABLE CARTRIDGES.
- 2.) FILTER #2 NEEDS TO BE PER CAGE BASIS. FILTER CARTRIDGE MUST BE 5 MICRON.

SCALE: -

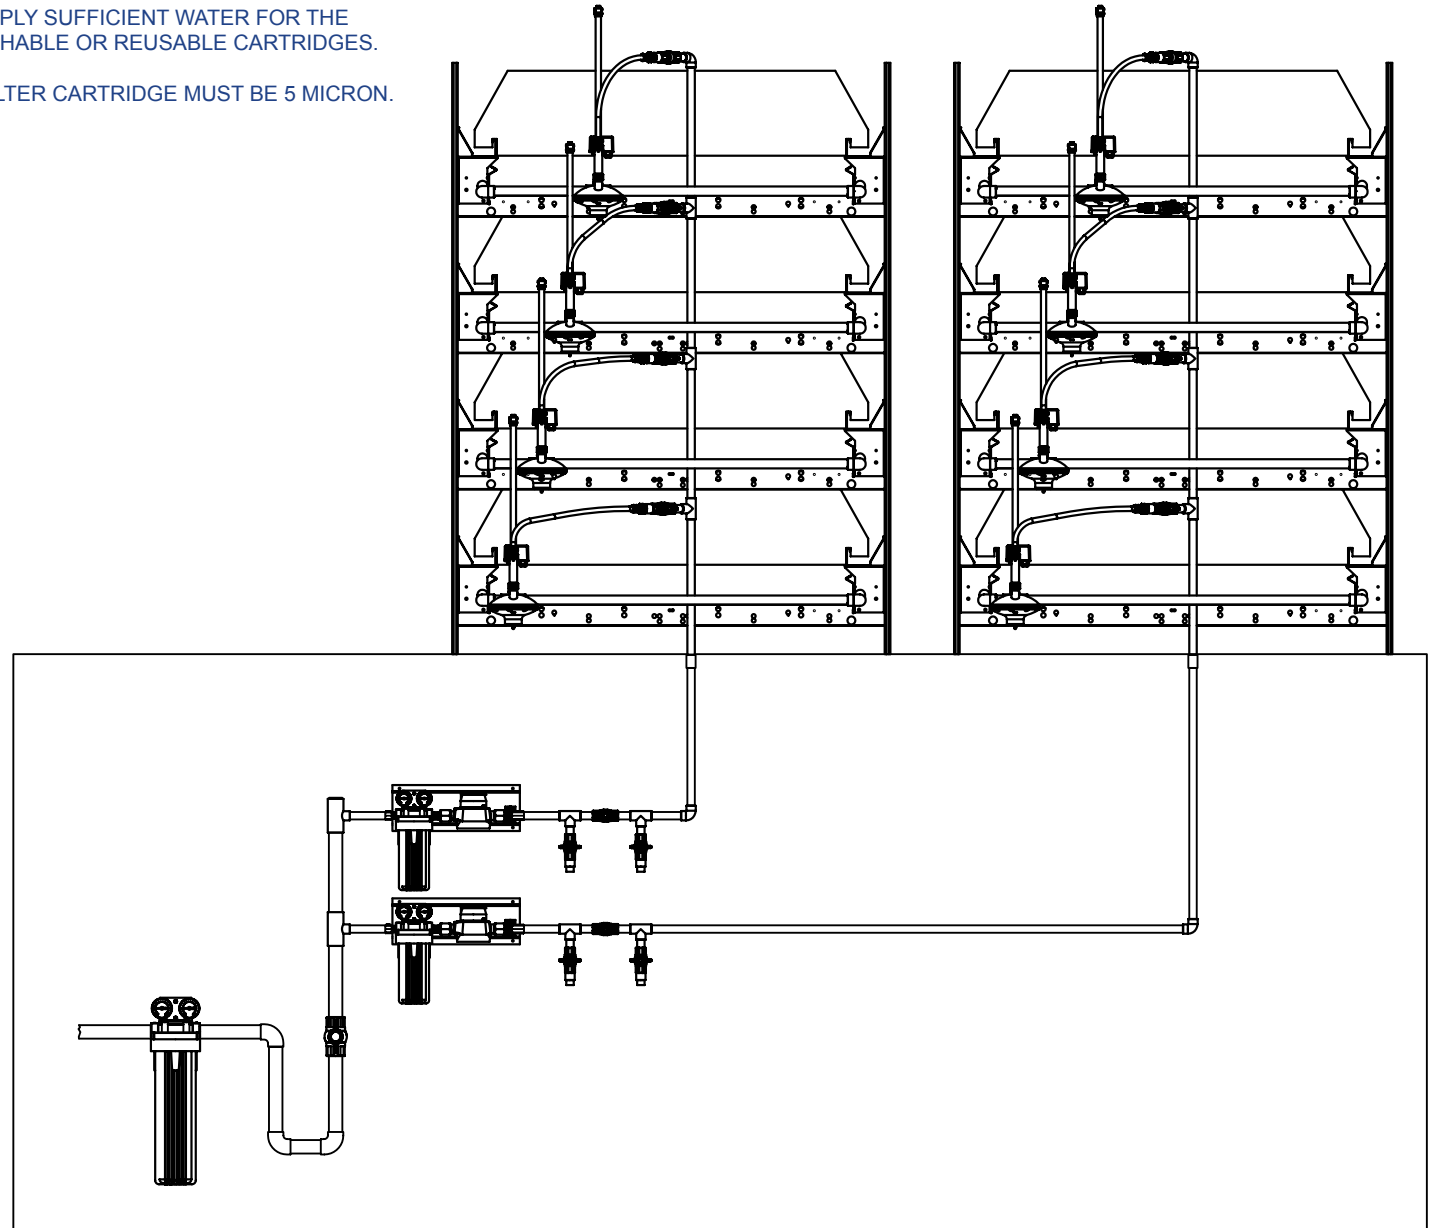

FILTER LAYOUT

DATE: 12-08-03

REVISION: 1

PART NR.:

GL1030